


4" WSP Pump Curve

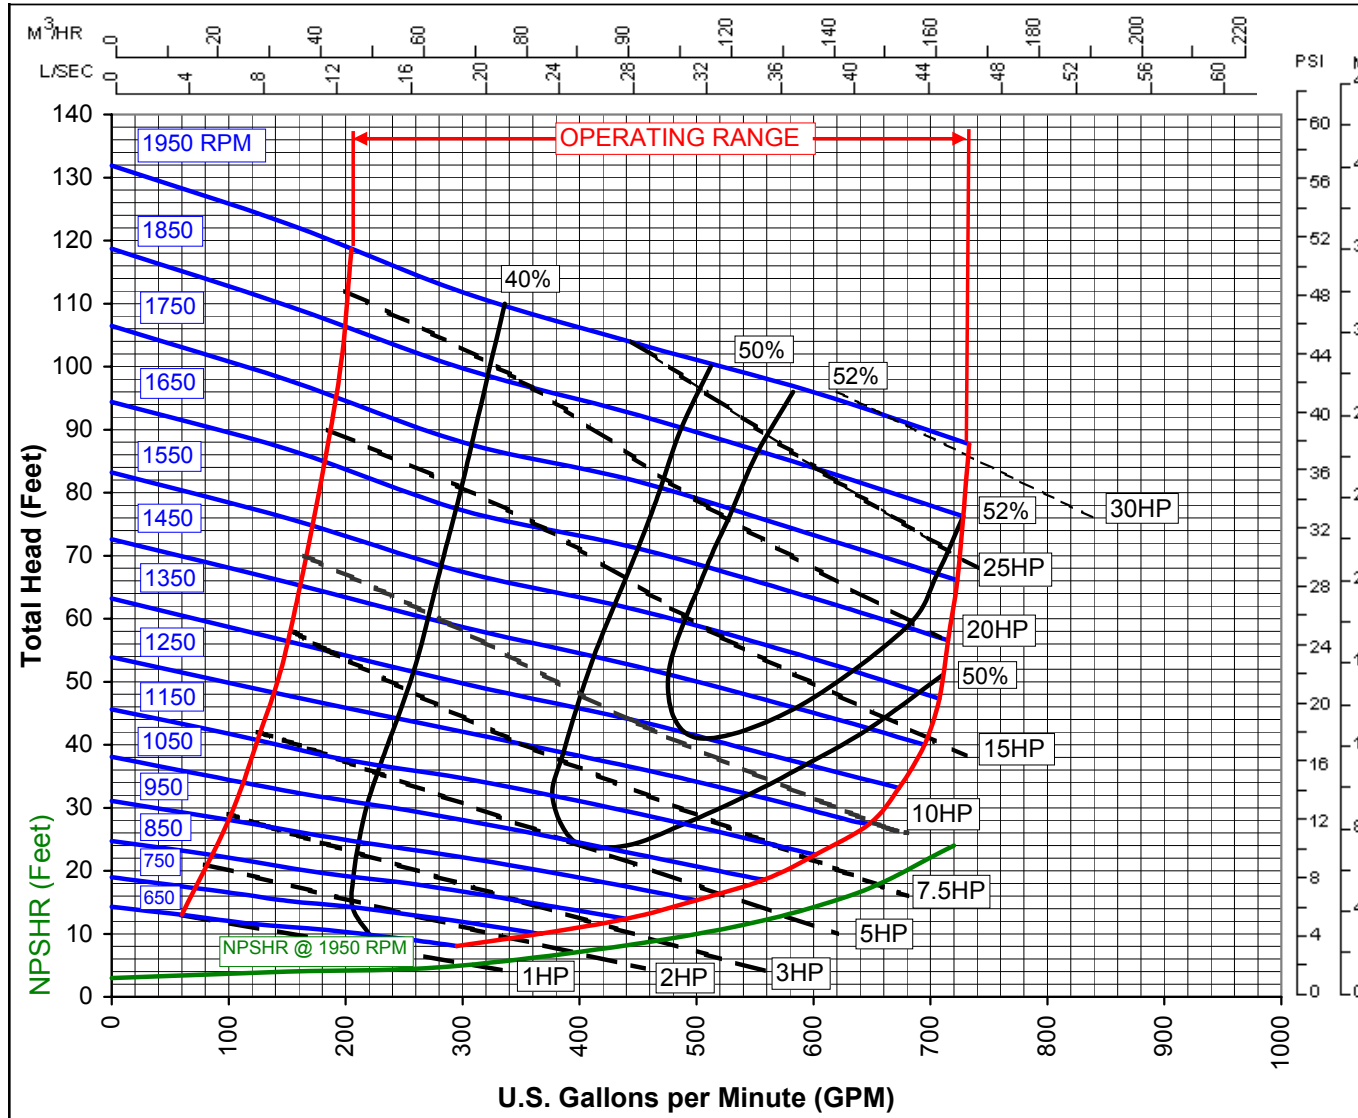

Suction: 4"
Discharge: 4"
Impeller Diameter: 9.75"
Max. Solid Sphere: 3.00"

REPRIMING LIFTS	
RPM	FEET
650	5
750	8
850	16
950	19
1050	22
1150	24
1250-1950	25

Determine NPSHR prior to using repriming table. Do not use available suction lifts.

Clear Water Performance

$$BHP = \frac{GPM \times FT \times SG}{3960 \times Efficiency}$$

$$KW = \frac{M^3 / HR \times M \times SG}{367 \times Efficiency}$$

© Copyright
All rights reserved



Certified tests are performed using Hydraulic Institute acceptance level B.

FEB. 2006

**RPM
VARIABLE**

WSP4A